


1

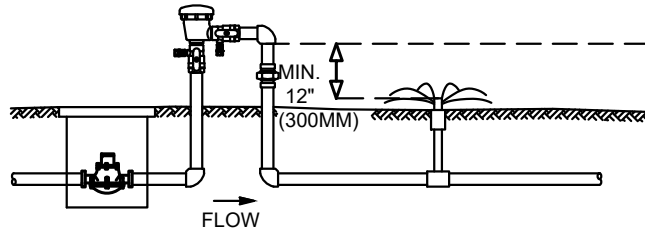

2


1 PRESSURE VACUUM BREAKER

2 MAY BE USED WITH DOWNSTREAM VALVES & MULTIPLE ZONES

NOTES:

1. SHALL BE INSPECTED BY SLWSD UPON INSTALLATION.
2. SHALL BE TESTED BY A WASHINGTON STATE CERTIFIED BACKFLOW ASSEMBLY TESTER
3. INSTALL AT LEAST 12" ABOVE HIGHEST SPRINKLER IN RESPECTIVE ZONE.
4. NEVER INSTALL BELOW GRADE.
5. MUST BE PROTECTED FROM FREEZING.
6. SHALL NOT BE MODIFIED IN ANY WAY.
7. MAY NOT BE INSTALLED ON SYSTEMS UTILIZING COMPRESSED AIR WINTERIZATION FITTING.
8. ASSEMBLY MUST BE APPROVED BY THE FOUNDATION FOR CROSS-CONNECTION AND HYDRAULIC RESEARCH AT THE UNIVERSITY OF SOUTHERN CALIFORNIA.

SCALE: NTS

 <p>Silver Lake Water & Sewer District</p>	
<p>PRESSURE VACUUM BREAKER</p>	
DATE: 11-2022	DWG: CC3