


**PLAN**

CUT EXISTING SERVICE LINE AND REMOVE ALL DCVA EQUIPMENT

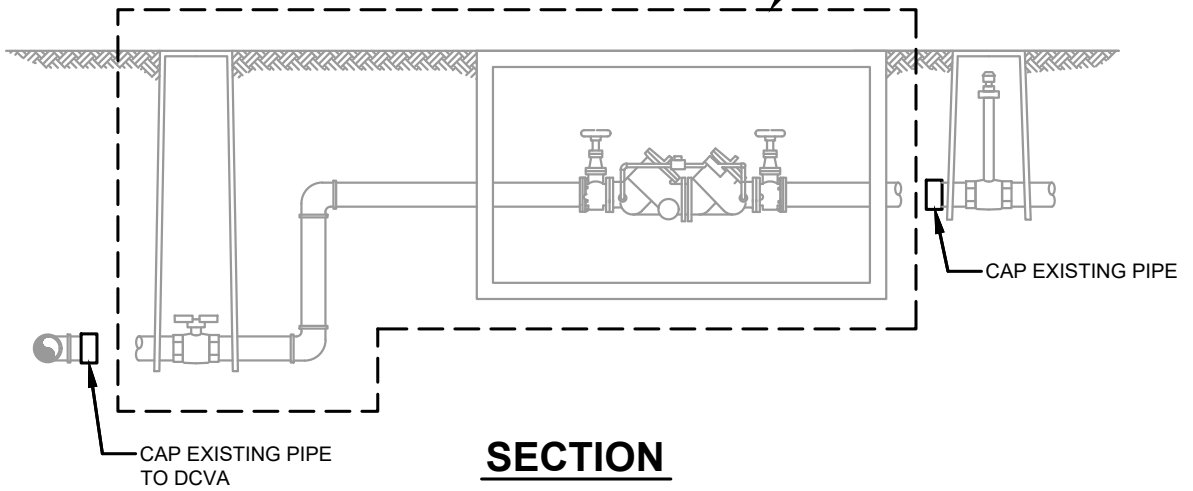


**SECTION**

**NOTES:**

1. ALL DCVA EQUIPMENT SHOWN ABOVE MUST BE REMOVED AND EXISTING PIPE SHALL BE CAPPED.
2. A SILVERLAKE WATER AND SEWER DISTRICT CROSS CONNECTION SPECIALIST MUST INSPECT BEFORE BURYING.
3. FREEZE PROTECTION IS THE RESPONSIBILITY OF THE OWNER.

SCALE: NTS

 <p><b>Silver Lake Water &amp; Sewer District</b></p>	
<p><b>DOUBLE CHECK VALVE ASSEMBLY (DCVA) DISCONNECTION/REMOVAL FOR ASSEMBLIES 3/4" TO 1"</b></p>	
DATE: 11-2022	DWG: CC4