


PLAN

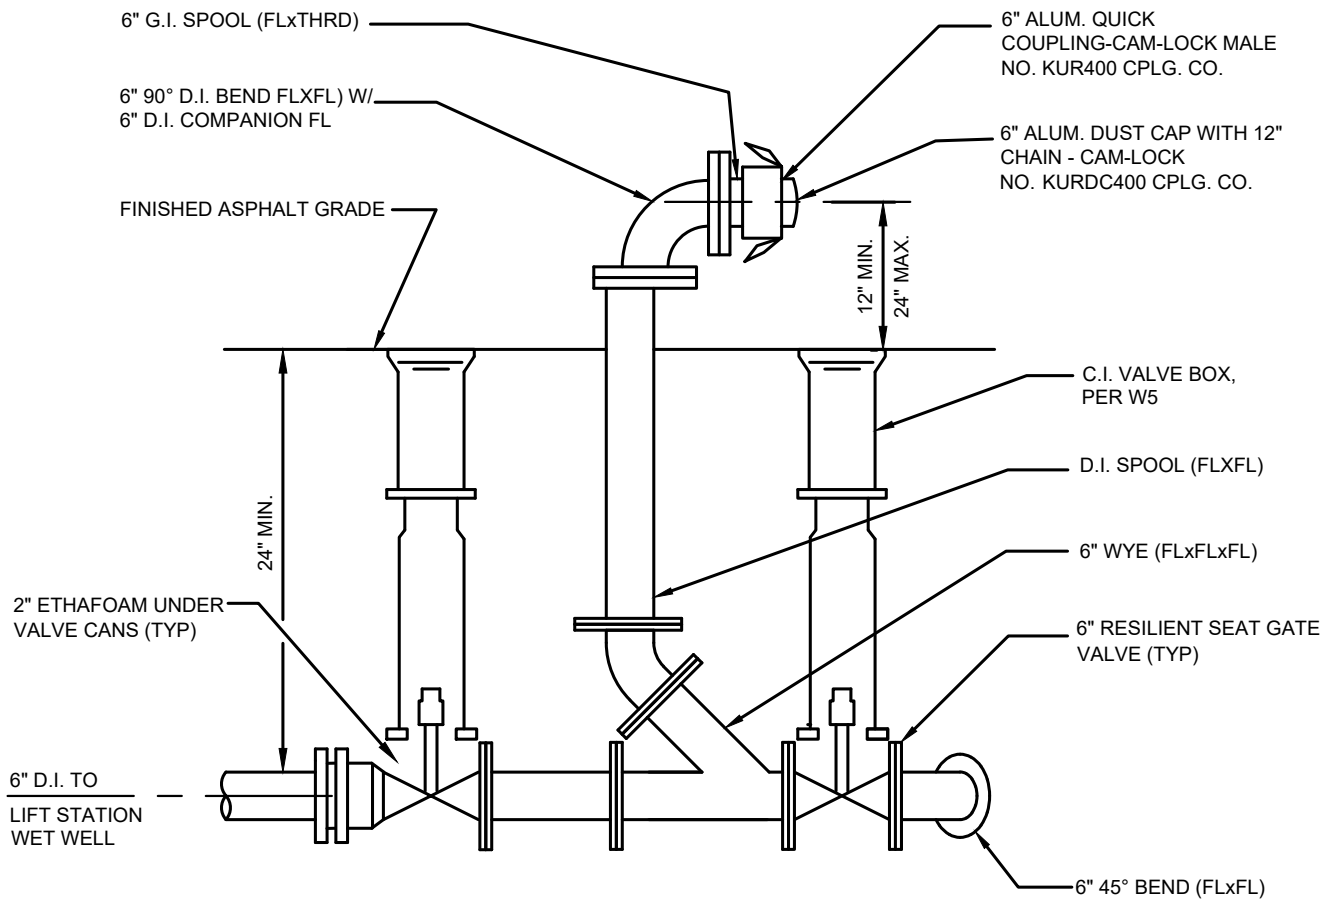

ELEVATION

NOTES:

1. LOCATE AND ORIENT PUMP CONNECTION AS DIRECTED BY SLWSD.
2. PIPE AND FITTINGS TO BE ADJUSTED BASED ON DISTANCE TO WET WELL (FLxPE, OR FLxMJ RESTRAINED)
3. SIZE SHOWN, LARGER SIZE MAY BE REQUIRED TO MEET STATION CAPACITIES.



Silver Lake Water & Sewer District

**FORCE MAIN BYPASS
PUMP CONNECTION**

DATE: 11-2022

DWG: S23A