


DOUBLE CHECK VALVES (TO MATCH PIPE DIAMETER) APPROVED IN WASHINGTON STATE, AND TESTED WITHIN 30 DAYS WHENEVER INSTALLED OR MOVED. PROVIDE CERTIFICATION TO DISTRICT



NOTES:

1. PROTECT INSTALLATION FROM DAMAGE AND FREEZING.
2. ALL WATER USED FOR FILLING AND FLUSHING SHALL BE METERED BY DISTRICT. PROVIDE SPACE FOR INSTALLATION OF METER OR INSTALL ON POINT OF DISCHARGE.
3. ALL NEW MAINS SHALL BE KEPT SEPARATE FROM THE DISTRICT'S EXISTING SYSTEM UNTIL THE NEW MAINS ARE TESTED AND ACCEPTED. FINAL CONNECTION REQUIRES 100% INSPECTION BY THE DISTRICT.
4. PROVIDE TEMPORARY BRACING OR BLOCKING AS APPROVED BY THE DISTRICT.

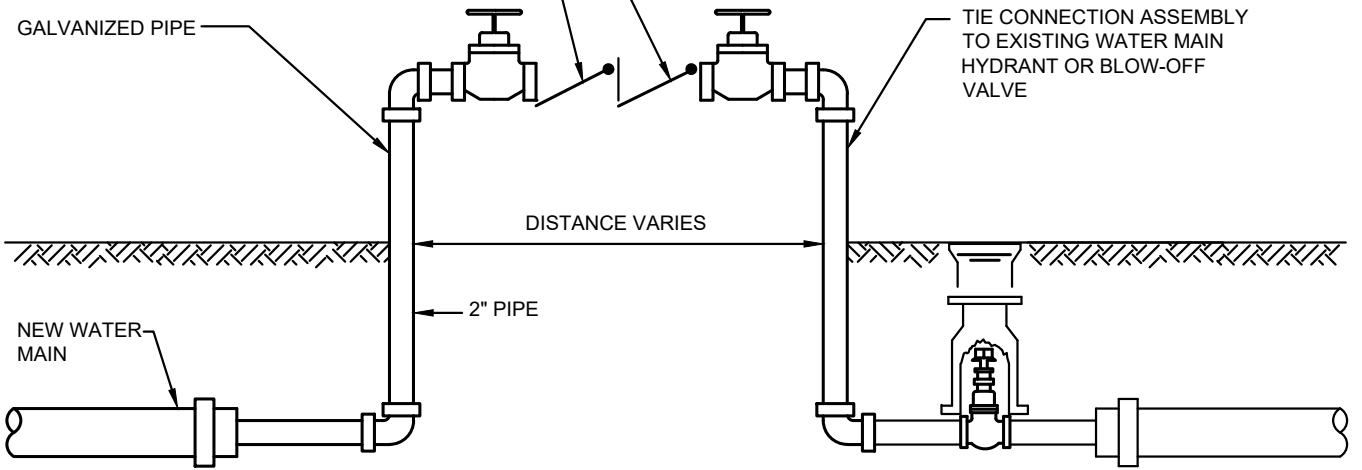

TESTING CONNECTION DETAIL

DATE: 11-2022

DWG: W9